

**Report  
For  
Indoor Air Quality Testing  
At The  
Middle School  
Ashland, MA**

**Study Date:**  
April 22, 2021

**Project# 221 231.00**

**STUDY CONDUCTED BY:**

***UNIVERSAL ENVIRONMENTAL CONSULTANTS***

12 Brewster Road  
Framingham, Massachusetts

April 23, 2021

Mr. Jonathan Murray  
Ashland Public Schools  
87 West Union Street  
Ashland, MA 01720

Reference: **Indoor Air Quality Testing  
Middle School, Ashland, MA**

Dear Mr. Murray:

Thank you for the opportunity for Universal Environmental Consultants (UEC) to provide professional services.

Enclosed please find the report for Indoor Air Quality testing at the Middle School, Ashland, MA conducted on Thursday, April 22, 2021.

Please do not hesitate to call should you have any questions.

Very truly yours,

Universal Environmental Consultants



---

Ammar M. Dieb  
President

UEC:\221 231.00\Middle Report.DOC

Enclosure

**Scope:**

UEC was contracted to perform an Indoor Air Quality testing at the Middle School, Ashland, MA. Testing was performed on Thursday, April 22, 2021.

**Methodology:**

Testing for Total Volatile Organic Compounds (**TVOC**) was performed using a Rae Systems "ppbRae 3000" Photo-ionization Detector (PID) with a 10.6 eV lamp. This is a state-of-the-art instrument capable of detecting **TVOC** in the ppb (parts per billion) and  $\mu\text{g}/\text{m}^3$  (micrograms per cubic meter) ranges. The instrument is a direct reading instrument and provides continuous results over an extended time. The unit is calibrated prior to use and serviced by an independent vendor annually.

Volatile organic compounds are a broad class of chemicals with diverse applications which are frequently emitted by new carpets, furniture, pressboards, varnishes, adhesives, and high gloss finishes. Other common products which may emit VOCs include construction materials, paints, paint strippers, other solvents, wood preservatives, aerosol sprays, cleansers, disinfectants, hand sanitizer, moth repellents, air fresheners, stored fuels, automotive products, hobby supplies, and dry-cleaned clothing. High levels of VOCs are a common Indoor Air Quality problem, especially in newly constructed, recently renovated, or currently being renovated buildings.

Carbon monoxide (**CO**), Carbon Dioxide (**CO<sub>2</sub>**), Temperature (**°F**) and Relative Humidity (**%RH**) were measured using a Q-Trak plus monitor manufactured by TSI Incorporated. The unit is calibrated prior to use and serviced by an independent vendor annually.

Hydrogen Sulfide (**H<sub>2</sub>S**), Oxygen (**O<sub>2</sub>**) and Lower Explosive Limit (**LEL**) were measured using a QRAE2 manufactured by Rae Systems Incorporated. The unit is calibrated prior to use and serviced by an independent vendor annually. Testing for **LEL** will check for any flammable gas. It does not call out natural gas specifically, but it checks for the presence of it along with other flammable gasses

Samples were collected for approximately 5 minutes at each test location. No TWA (8-hour time weighted average) or other types or methods of sampling were included in the scope of work.

Airborne particulate matter (**PM**) levels for **PM<sub>10</sub>** and **PM<sub>2.5</sub>** were tested using a TSI Corporation DustTrak DRX 8534 handheld aerosol monitor (S/N 8534124302). This is a state-of-the-art instrument capable of simultaneously detecting **PM<sub>10</sub>** and **PM<sub>2.5</sub>** in the microgram per cubic meter ( $\mu\text{g}/\text{m}^3$ ) range. The instrument is a direct reading monitor and provided sampling readings at 1 second intervals over the duration of each test. The instrument was zeroed prior to testing and is serviced annually by the manufacturer or an independent vendor.

Real time **PM** Measurement is a useful comparative measure of indoor and outdoor dust levels as well as identifying indoor sources of **PM**.

**Results:**

**TEMPERATURE, RELATIVE HUMIDITY, CARBON MONOXIDE, CARBON DIOXIDE & TOTAL VOLATILE ORGANIC COMPOUNDS by PID**

Location	W	D	#	T	RH	CO	CO <sub>2</sub>	TVOC (ug/m <sup>3</sup> )
Outside	-	-	-	40.8	31.2	0.0	388	0
Activity Room	C	O	0	62.5	17.4	0.0	418	0
Room 103	C	C	1	65.4	30.6	0.0	484	0
Room 106	C	C	2	70.3	25.4	0.0	518	82
Facilities	-	C	1	69.2	26.0	0.0	461	80
Library	C	C	0	66.6	23.2	0.0	403	119
Room 123	C	O	0	64.6	24.7	0.0	400	144
Room 114	O	O	0	63.5	20.8	0.0	392	48
Theater	-	O	0	65.1	26.2	0.0	416	2,173
Resource Office	-	C	0	67.5	22.3	0.0	415	1,520
Room 130	C	O	0	67.4	17.5	0.0	397	524
Room 223	C	O	0	66.8	22.2	0.0	403	259
Room 226	C	O	0	67.0	21.7	0.0	399	144
Room 220	C	O	0	65.5	22.4	0.0	394	48
Room 235	C	O	0	66.4	22.4	0.0	391	20
Room 205	C	O	0	70.1	19.9	0.0	409	133
Room 212	C	O	0	70.4	21.8	0.0	396	98

**HYDROGEN SULFIDE (H<sub>2</sub>S), OXYGEN (O<sub>2</sub>) AND LOWER EXPLOSIVE LIMIT (LEL)**

Location	H <sub>2</sub> S	O <sub>2</sub>	LEL
Activity Room	0.0	20.9	0.0
Room 103	0.0	20.9	0.0
Room 106	0.0	20.9	0.0
Facilities	0.0	20.9	0.0
Library	0.0	20.9	0.0
Room 123	0.0	20.9	0.0
Room 114	0.0	20.9	0.0
Theater	0.0	20.9	0.0
Resource Office	0.0	20.9	0.0
Room 130	0.0	20.9	0.0
Room 223	0.0	20.9	0.0
Room 226	0.0	20.9	0.0
Room 220	0.0	20.9	0.0
Room 235	0.0	20.9	0.0
Room 205	0.0	20.9	0.0
Room 212	0.0	20.9	0.0

**Total PM - PM<sub>10</sub>, Respirable, PM<sub>2.5</sub> and PM1**

Location	Total PM	PM 10 (mg/m <sup>3</sup> )	Respirable (mg/m <sup>3</sup> )	PM 2.5 (mg/m <sup>3</sup> )	PM1 (mg/m <sup>3</sup> )
Activity Room	0.019	0.003	0.001	0.001	0.001
Room 103	0.018	0.005	0.002	0.001	0.000
Room 106	0.002	0.001	0.001	0.000	0.000
Facilities	0.005	0.001	0.000	0.000	0.000
Library	0.009	0.001	0.001	0.000	0.000
Room 123	0.001	0.001	0.001	0.000	0.000
Room 114	0.003	0.001	0.001	0.001	0.001
Theater	0.001	0.001	0.001	0.000	0.000
Resource Office	0.040	0.005	0.002	0.002	0.001
Room 130	0.002	0.001	0.001	0.001	0.001
Room 223	0.008	0.002	0.001	0.001	0.001
Room 226	0.001	0.001	0.000	0.000	0.000
Room 220	0.001	0.001	0.000	0.000	0.000
Room 235	0.001	0.000	0.000	0.000	0.000
Room 205	0.002	0.001	0.001	0.000	0.000
Room 212	0.005	0.001	0.001	0.000	0.000

**Legend:**

µg/m<sup>3</sup> - micrograms per cubic meter, ppm - parts per million, ppb - parts per billion

ND - Not Detected, CO OSHA PEL is 30 ppm, ACGIH TLV is 25 ppm.

CO<sub>2</sub> - OSHA PEL is 5000 ppm, Mass DOH Guideline is 800 ppm

TVOC – UEC suggested guideline of 100 ppb; Seifert “Target Guideline Value” of 0.3 mg/m<sup>3</sup>

ND - Not Detected

W/D: Windows and Doors (Open/Closed)

#: Number of Occupants

## Observations and Interpretation of Results:

### Temperature and Relative Humidity (T & RH)

The outside **T** and **RH** were approximately 40.8°F and 31.2%. Massachusetts Department of Public Health (MDPH) recommends that indoor air temperatures be maintained in a range of 70 - 78 °F and 40 to 60 % for indoor air relative humidity to provide for the comfort of building occupants.

Interior **T** and **RH** were 62.5°F – 70.4°F and 17.5% – 30.6% during the test period. Interior temperature tests were lower than the MDPH recommended temperature range of 70 - 78 °F. Interior relative humidity tests were lower than the MDPH recommended relative humidity range of 40 to 60 %.

### TVOC

**TVOC** levels on this day were lower than the Seifert “Target Guideline Value” of 300-µg/m<sup>3</sup> except on the first floor near the gymnasiums. Both gymnasiums had the floors refinished the day before testing causing high levels of **TVOC** while the finish dries. The Seifert Target Guideline Value (reference #3 and #8 below) is a widely recognized **TVOC** guideline for pollutant levels based on Seifert’s personal judgment, rather than on toxicological data, for long term exposure. Seifert proposed that 1 week after completion of construction or renovation **TVOC** concentration of 50 times higher be acceptable (i.e., 15,000 µg/m<sup>3</sup>.) and after 6 weeks, 10 times higher be acceptable (i.e., 3,000 µg/m<sup>3</sup>). **TVOC** test levels were between 0 ug/m<sup>3</sup> and 2,173 ug/m<sup>3</sup>, mostly lower than the Seifert target guideline of 300 ug/m<sup>3</sup>, lower than the 1-week post-construction/renovation acceptable limit of 15,000 ug/m<sup>3</sup> and the 6-week post-construction/renovation acceptable limit of 3,000 ug/m<sup>3</sup>.

Neither OSHA (Occupational Safety and Health Administration) nor ACGIH (American Conference of Governmental Industrial Hygienists) promulgates exposure standards for **TVOC** that relate to protection of the general population as opposed to industrial occupational standards. Both have limits on individual VOCs, but they relate to industrial occupational standard.

Testing conducted was of short duration and did not assess representative full-day occupancy levels. Measurements were made using a real-time, portable **TVOC** monitor referenced to isobutylene and not by sample collection for individual VOC analysis by gas chromatography technique and evaluation based on Seifert’s chemical classes. Møhlhave of Denmark reported at INDOOR AIR '90 (reference #8 below) on low levels of indoor air VOCs and human health. Berg summarized Møhlhave’s findings as follows.

Table 4.5 Tentative Dose-Response Relationship for Discomfort Resulting from Exposure to Solvent-Like VOCs

Total concentration (ug/m <sup>3</sup> )	Irritation and discomfort	Exposure
200	No irritation or discomfort	The comfort range
200 – 3,000	Irritation and discomfort possible if other exposures interact	The multifactorial exposure range
3,000 – 25,000	Exposure effect and probable headache possible if other exposures interact	The discomfort range
> 25,000	Additional neurotoxic effects other than headache may occur	The toxic range

**TVOC** test levels were between 0 ug/m<sup>3</sup> and 2,173 ug/m<sup>3</sup>.

### Carbon Monoxide

No **CO** was detected during testing.

### Carbon Dioxide

All **CO<sub>2</sub>** levels were within the acceptable range. For comparative purposes, fresh outdoor air has approximately 400 ppm of **CO<sub>2</sub>**. All areas were well below the OSHA/NIOSH limit of 5000 ppm, and below the MDPH guideline of 800 ppm for publicly occupied buildings. MDPH recommends an optimal level of below 600 ppm. Exposure to high levels of **CO<sub>2</sub>** for prolonged periods could cause building

occupants to become lethargic and generally uncomfortable. **CO<sub>2</sub>** levels will rise over the course of the day especially in those areas which have a high occupancy. CO<sub>2</sub> at these levels is a comfort as opposed to a health issue.

**Hydrogen Sulfide (H<sub>2</sub>S), Oxygen (O<sub>2</sub>) and Lower Explosive Limit (LEL)**

No H<sub>2</sub>S was detected. O<sub>2</sub> Levels were within recommended level of 20.9% and no LEL was detected.

**Airborne Particulate Matter (Dust):**


Dust monitoring is one aspect of air quality that an industrial hygienist can use to determine the amount of dust particles present in the workplace, cities or communities over a given period.

The Particulate Matter (PM) monitoring focused on measuring a range of particulate sizes in the air that are equal to or less than 10 micrometers (PM10) and equal to or less than 2.5 micrometers (PM2.5) in diameter (course dust and fine dust respectively), i.e., PM capable of penetrating the outer defenses of the respiratory tract, such as the mouth and nose, and can pass into the lungs based on PM size. PM air pollutants include but are not limited to soot, smoke, salts, metals, acids and soil and road dust. These pollutants are typically monitored along work site fence lines, industrial complexes, during wildfires, and high traffic areas (vehicle exhaust).

EPA's health-based National Ambient Air Quality Standard (NAAQS) for PM10 is 150-µg/m<sup>3</sup> and for PM2.5 is 35-µg/m<sup>3</sup> (measured as a 24-hours period concentration) for outdoor (ambient) air. The OSHA Permissible Exposure Limit (PEL) for occupational exposure for respirable dust is 5-mg/m<sup>3</sup> (5,000-µg/m<sup>3</sup>) for a time-weighted average (8 hour) exposure. While the EPA NAAQS is an outdoor, ambient air standard, it is a useful reference guide for acceptable air quality in general with limits far below OSHA worker compliance requirement levels.

The TSI DustTrak DRX 8534 real-time PM monitor used in this survey can measure PM simultaneously as PM10, PM<sub>resp</sub>, PM2.5 and PM1, i.e., particles in the size range categories of 10, Respirable (4), 2.5 and 1 micrometer diameter.

Figure 1.1-Visual Particle Size Comparison Chart.

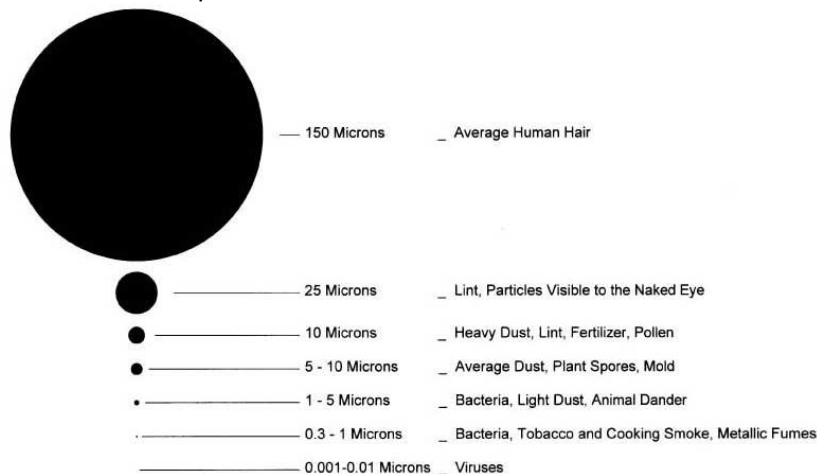

Levels of PM10 recorded in areas tested during the survey ranged from **0 to 5-µg/m<sup>3</sup> or 0.0 to 0.005-mg/m<sup>3</sup>**. EPA's health-based National Ambient Air Quality Standard (NAAQS) recommended level for PM10 is **150-µg/m<sup>3</sup> or 0.150-mg/m<sup>3</sup>**. All areas tested during the survey were below the EPA recommended level.

Levels of PM<sub>resp</sub> (respirable dust) recorded in areas tested during the survey ranged from **0 to 2-µg/m<sup>3</sup> or 0.0 to 0.002-mg/m<sup>3</sup>**. OSHA PEL limit for PM<sub>resp</sub> is **5,000-µg/m<sup>3</sup> or 5-mg/m<sup>3</sup>**. All areas tested during the survey were below the OSHA PEL limit.

Levels of PM<sub>2.5</sub> recorded in areas tested during the survey ranged from **0 to 2-µg/m<sup>3</sup> or 0.0 to 0.002-mg/m<sup>3</sup>**. EPA's health-based National Ambient Air Quality Standard (NAAQS) recommended level for PM<sub>2.5</sub> is **35-µg/m<sup>3</sup> or 0.035-mg/m<sup>3</sup>**. All areas tested during the survey were below the EPA recommended level.

Direct reading PM monitors are not a reference method for OSHA compliance Respirable Dust testing. However, the direct reading instrument is useful in providing accurate order of magnitude evaluation of Respirable Dust levels.

Samples were collected for approximately 10 minutes at each test location and results/levels are not based on TWA (8-hour time weighted average).

#### **Conclusions and Recommendations:**

Interior temperature tests were lower than the MDPH recommended temperature range of 70 - 78 °F. Interior relative humidity tests were lower than the MDPH recommended relative humidity range of 40 to 60 %. **TVOC** levels on this day were lower than the Seifert "Target Guideline Value" of 300-µg/m<sup>3</sup> except on the first floor near the gymnasiums. Both gymnasiums had the floors refinished the day before testing causing high levels of **TVOC** while the finish dries. **TVOC** levels will dissipate with time.

All other IAQ parameters tested were within the acceptable ranges.



**Limitations and Conditions:**

This report has been completed based on visual and physical observations made and information available at the time of the site visits. This report is intended to be used as a summary of available information on existing conditions with conclusions based on a reasonable and knowledgeable review of evidence found in accordance with normally accepted industry standards, state, and federal protocols, and within the scope and budget established by the client. Any additional data obtained by further review must be reviewed by UEC and the conclusions presented herein may be modified accordingly.

This report and attachments, prepared for the exclusive use of Owner for use in an environmental evaluation of the subject site, are an integral part of the inspections and opinions should not be formulated without reading the report in its entirety. No part of this report may be altered, used, copied, or relied upon without prior written permission from UEC, except that this report may be conveyed in its entirety to parties associated with Owner for this subject study.

**REFERENCES:**

1. ACGIH, Threshold Limit values and Biological Exposure Indices, 2007.
2. AIHA, 2700 Prospect Ave., Fairfax, VA. IAQ Paper #130 June 23, 1999.
3. Seifert, B. Regulation Indoor Air. In: Indoor Air '90, Proceedings of the 5th International Conference on Indoor Air Quality and Climate, Volume V, p. 35. Toronto 1990.
4. American Society of Heating, Refrigeration and Air-conditioning Engineers' ANSI/ASHRAE 55-1992 "**Thermal Environmental Conditions for Human Occupancy.**"
5. BOCA, 1993. The BOCA National Mechanical Code 1993 8th edition Building Officials and Code Administrators International., Inc., Country Club Hills, Ill
6. SBBRS, 1997. Mechanical Ventilation, State Board of Building Regulations and Standards Code of Massachusetts Regulations 780 CMR 1209.0
7. Field Guide for the Determination of Biological Contaminants in Environmental Samples. (2005)
8. Bearg, David W. Indoor Air Quality and HVAC Systems (1993) Pages 76, 77 and others